




Water Quality analysis - 2012 Quick Info

Source	PH	Calcium	Magnesium	Sulfate	Chloride	Alkalinity
Green River	7.75	4.7	0.8	1.4	2.8	20.5
North Fork Wells	7.14	4.43	0.91	1.29	1.1	15
1-B	7.5	19	10.5	13	6.1	83
2-C	7.47	5.21	2.56	<10	1.93	68.5
3-A	6.87	23.1	10.6	11	5.9	85.6
4-A	6.96	21.7	14	16	14	111
5-A	7.02	21.9	12.1	15.5	5.79	84
6-B	7.26	14.8	10.7	13.5	6.7	71
7-B	7.16	17.2	7.9	8.4	4.73	69
8-B	7.24	20.2	11.6	13	6.6	84
9-A	6.67	21.5	18.4	17	8.8	104
10-C	6.97	24.6	13.4	13	6.6	109
11-A	7.21	17.4	12.2	14	<20	81
12-A	6.89	24.6	21.5	23	8	137
13-A	7.5	7.71	4.61	0.237	1.54	60
GPL-1	6.71	20	10.9	<10	<20	85
GPL-2	6.79	20.4	11.3	8	6.16	88.7
PA-1	6.7	12.7	6.6	3.1	2.2	60.3
SE-11/11A	7.2	17.4	9.4	6.7	5.1	77.1
SE-2/6	7.23	14.8	8.3	8.2	6.3	62.2
SE-8	6.68	17.4	11.4	10	8.7	80
Prairie Springs	7.53	31.4	9.6	11	6.3	105
Treatment Plant	7.68	13.8	1.41	<10	<20	52

Primary source year round is Green River water, supplemented by North Fork well water.

** In town & county wells usually used when Green River exceeds turbidity limits**

Average yearly water temp

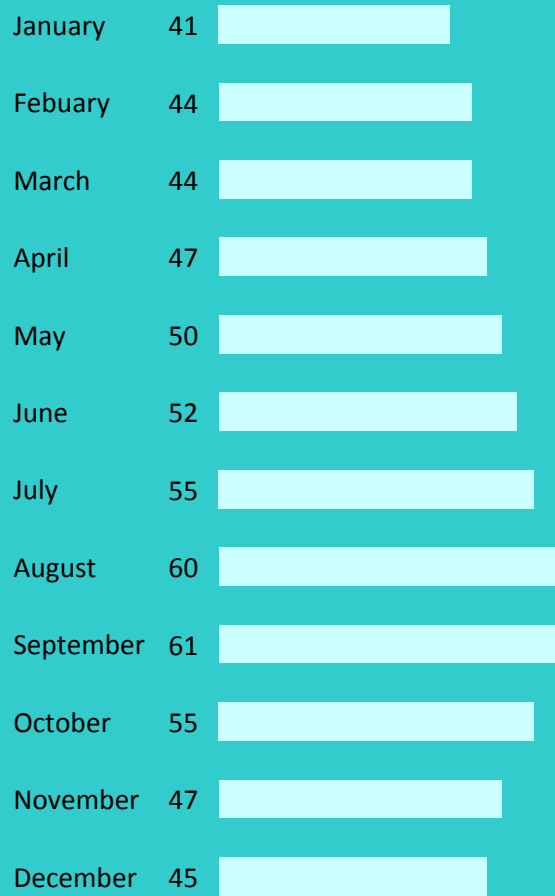

* As measured from tideflats area of Tacoma*